


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA CRUDA
may-17

RESULTADOS EN MG/LT


FECHA:	2	3	4	5	8	9	10	11	12	15	16	17	18	19	22	23	24	25	26	29	30	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	31.9	36.9	30.0	37.2	26.4	21.4	23.8	23.7	17.2	17.9	17.0	29.9	14.1	13.5	20.7	17.8	14.2	18.1	20.6	16.6	18.2	15.1	5 NTU	22.0
P.H.	7.7	7.7	7.7	7.6	7.7	7.7	7.7	7.7	7.8	8	7.8	7.9	7.7	7.6	7.6	7.7	8	7.8	7.9	7.8	7.7	7.9	6.5-8.5	7.8
ALCALINIDAD TOTAL	88	80	80	100	78	84	82	92	86	92	90	104	104	84	90	102	90	98	86	92	90	94		90.3
DUREZA TOTAL	280	280	290	296	290	290	290	284	270	290	300	310	314	320	320	300	312	300	310	290	300	320	500 MG/LT	296.6
CLORUROS	148	160	164	167	185	150	155	170	180	190	170	175	180	170	175	165	195	190	198	190	177	180	250 MG/LT	173.4
CLORO RESIDUAL																								
CALCIO	140	120	172	170	170	174	160	168	190	1990	186	190	190	210	140	144	190	170	200	180	190	170		255.2
MAGNESIO	140	160	118	126	90	116	130	116	80	100	114	120	124	170	180	156	122	130	110	110	110	150		126.0
SDT	480	490.5	502	502.5	500	513	510	515	513	502.5	522.5	522.5	533	520	516	532	521.5	530	542	542	527	507.5	1000 MG/LT	515.6

Realizó

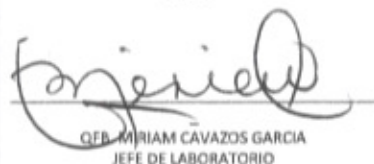

QFB. MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

Vo. Bo.

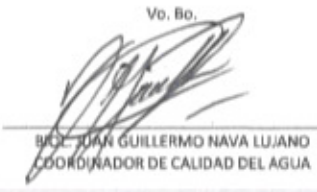

BQL. JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA