


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA POTABLE
jun-17

RESULTADOS EN MG/LT


| FECHA | 5 | 6 | 7 | 8 | 9 | 12 | 13 | 14 | 15 | 16 | 19 | 20 | 21 | 22 | 23 | 26 | 27 | 28 | 29 | 30 | NOM-127/94 | PROMEDIO |
|-------------------|-----|-------|-------|-----|-----|-----|-----|-----|-----|-----|-------|-----|-------|-------|-------|-----|-------|-------|-----|-----|------------|----------|
| TURBIEDAD N.T.U. | 3.9 | 3.5 | 4.3 | 3.9 | 4.3 | 3.5 | 4.1 | 4.1 | 4.1 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 4.9 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5 NTU. | 4.5 |
| P.H. | 7.2 | 7.5 | 7.5 | 7.5 | 7.4 | 7.4 | 7.4 | 7.4 | 7.5 | 7.5 | 7.5 | 7.5 | 7.4 | 7.4 | 7.4 | 7.4 | 7.4 | 7.4 | 7.5 | 7.6 | 6.5-8.5 | 7.4 |
| ALCALINIDAD TOTAL | 154 | 94 | 120 | 132 | 106 | 110 | 108 | 104 | 108 | 104 | 110 | 112 | 114 | 102 | 124 | 100 | 104 | 116 | 100 | 110 | | 111.6 |
| DUREZA TOTAL | 294 | 260 | 332 | 344 | 380 | 356 | 354 | 320 | 320 | 322 | 304 | 310 | 318 | 310 | 396 | 276 | 284 | 226 | 292 | 348 | 500 MG/LT | 317.3 |
| CLORUROS | 185 | 230 | 245 | 224 | 243 | 182 | 170 | 215 | 196 | 215 | 200 | 184 | 218 | 210 | 200 | 230 | 227.5 | 220 | 217 | 225 | 250 MG/LT | 211.8 |
| CLORO RESIDUAL | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | | 1.5 |
| CALCIO | 160 | 70 | 182 | 200 | 206 | 192 | 182 | 144 | 152 | 106 | 114 | 130 | 124 | 118 | 106 | 156 | 260 | 98 | 104 | 150 | | 147.8 |
| MAGNESIO | 134 | 190 | 150 | 144 | 174 | 164 | 172 | 176 | 168 | 216 | 190 | 180 | 194 | 192 | 288 | 120 | 24 | 128 | 188 | 198 | | 169.5 |
| SDT | 527 | 566.5 | 616.5 | 612 | 632 | 703 | 618 | 567 | 564 | 541 | 516.5 | 517 | 522.5 | 531.5 | 503.5 | 510 | 535 | 530.5 | 527 | 529 | 1000 MG/LT | 560.3 |

Realizó

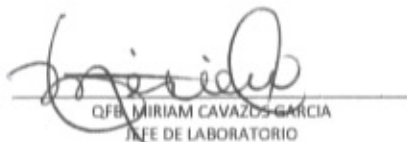

QFB MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

Vo. Bo.

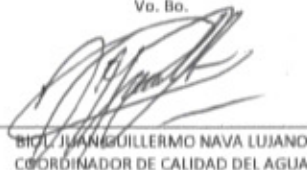

BIOL. JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA