


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA POTABLE
 jul-17

RESULTADOS EN MG/LT


FECHA:	3	4	5	6	7	10	11	12	13	14	17	18	19	20	21	24	25	26	27	28	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	5.0	5.0	4.9	4.5	5.0	3.3	3.7	5.0	5.0	4.1	4.0	3.2	3.1	3.1	3.4	4.7	4.2	5.0	5.0	4.9	4.7	5 NTU.	4.3
P.H.	7.5	7.5	7.3	7.5	7.2	7.6	7.4	7.5	7.5	7.4	7.4	7.5	7.2	7.5	7.4	7.5	7.4	7.4	7.5	7.3	7.5	6.5-8.5	7.4
ALCALINIDAD TOTAL	66	70	78	130	118	114	106	118	116	72	106	120	122	98	110	130	100	118	118	100	120		106.3
DUREZA TOTAL	302	304	320	300	332	280	318	326	312	314	314	318	324	330	318	294	290	316	330	320	296	500 MG/LT	312.3
CLORUROS	221	240	250	230	237	240	225	235	234	234	221	220	230	240	231	224	225	220	244	235	207	250 MG/LT	231.0
CLORO RESIDUAL	1.5	1.5	1.1	1.1	1.4	1	1	1	1	1.2	1.2	1.3	1.4	1.1	1.5	1.2	1.5	1.5	1.5	1.5	1		1.3
CALCIO	130	126	130	110	120	182	190	222	214	210	196	200	202	248	260	138	186	220	200	216	220		186.7
MAGNESIO	172	178	190	190	212	98	128	106	98	104	118	118	122	82	58	156	104	132	130	104	76		127.4
SDT	536.5	573.5	551.5	534	573.5	534.5	542	549.5	555	544	535	530	537.5	551.5	555	522	546.5	550	575	557	524	1000 MG/LT	546.5

Realizó

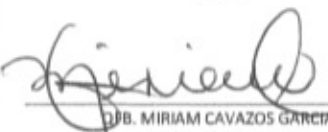

D.B. MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

Vo.Bo.



BIOL. JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA