


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA CRUDA
dic-17

RESULTADOS EN MG/LT


FECHA:	1	4	5	6	7	8	11	12	13	14	15	13	19	20	21	22	25	26	27	28	29	NCM-127/94	PROMEDIO
TURBIEDAD N.T.U.	11.0	10.9	11.6	10.7	10.1	13.3	9.4	9.8	9.3	9.2	9.0	7.2	9.1	9.8	10.6	10.0		10.1	10.7	9.2	10.2	5 N.T.U.	10.1
P.H.	8.1	8.1	7.7	8.0	8.0	7.9	8.0	7.8	8.1	8.0	8.1	7.8	7.9	7.7	7.7	8.0		7.9	7.9	7.8	7.8	6.5-8.5	7.9
ALCALINIDAD TOTAL	150	136	146	132	140	123	148	146	142	142	150	146	140	158	144	154		136	142	118	144		141.9
DUREZA TOTAL	252	248	244	240	252	220	258	260	264	252	246	254	262	252	206	260		246	200	232	280	500 MG/LT	253.4
CLORUROS	169	128	133	148	143	120	148	152	145	146	153	134	158	159	160	164		176	157	180	172	250 MG/LT	153.7
CALCIO	178	160	136	184	182	153	192	202	182	194	194	176	194	132	190	168		206	210	190	194		186.5
MAGNESIO	74	88	78	56	70	64	66	58	62	58	52	78	68	30	76	62		40	50	42	88		66.9
SDT	419	435	422	390	420	416	450	427	420	422	400	400	405	410	435	433		480	460	490	495	1000 MG/LT	430.5

Realizó

P.A. 

CFB. MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

Ver. Bo.

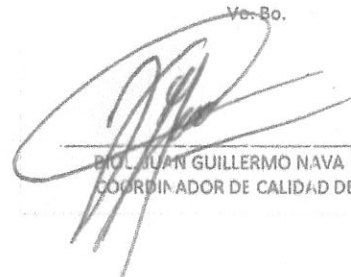
BIOL. JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA