

**PLANTA POTABILIZADORA PASTOR LOZANO  
ANALISIS FISICOQUÍMICOS  
AGUA POTABLE  
ene-18**


**RESULTADOS EN MG/LT**

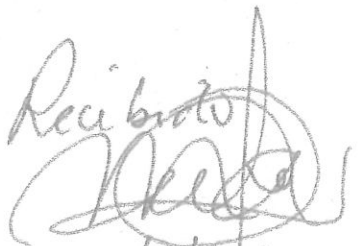
| FECHA             | 2   | 3   | 4   | 5   | 8   | 9   | 10  | 11  | 12  | 15  | 18  | 17  | 18  | 19  | 22  | 23  | 24  | 25  | 26  | 29  | 30  | 31  | NOM-127/94 | PROMEDIO |
|-------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------------|----------|
| TURBIEDAD N.T.U   | 2.7 | 2.2 | 2.1 | 2.0 | 3.0 | 2.0 | 2.2 | 2.8 | 3.0 | 5.0 | 5.0 | 5.0 | 3.3 | 3.3 | 5.0 | 4.8 | 5.0 | 5.0 | 4.9 | 5.0 | 4.8 | 5.0 | 5 NTU.     | 3.8      |
| P.H               | 7.3 | 7.3 | 7.5 | 7.4 | 7.4 | 7.4 | 7.4 | 7.4 | 7.5 | 7.3 | 7.4 | 7.3 | 7.4 | 7.4 | 7.3 | 7.4 | 7.4 | 7.4 | 7.3 | 7.3 | 7.3 | 7.3 | 6.5-8.5    | 7.4      |
| ALCALINIDAD TOTAL | 110 | 104 | 110 | 122 | 112 | 110 | 114 | 110 | 98  | 140 | 114 | 110 | 114 | 110 | 116 | 120 | 104 | 110 | 102 | 106 | 102 | 110 |            | 111.3    |
| DUREZA TOTAL      | 252 | 248 | 288 | 294 | 310 | 296 | 306 | 296 | 284 | 278 | 280 | 288 | 326 | 324 | 318 | 326 | 330 | 318 | 340 | 340 | 328 | 310 | 500 MG/LT  | 302.6    |
| CLORUROS          | 122 | 139 | 136 | 174 | 160 | 175 | 172 | 178 | 172 | 129 | 156 | 160 | 154 | 152 | 170 | 174 | 170 | 170 | 170 | 160 | 165 | 164 | 250 MG/LT  | 160.1    |
| CLORO RESIDUAL    | 1.5 | 1.4 | 1.5 | 1.2 | 1.1 | 1   | 1.5 | 1.1 | 1.3 | 1.5 | 1.4 | 1   | 1   | 1   | 1   | 1   | 1.1 | 1.1 | 1.1 | 1   | 1.2 | 1.1 |            | 1.2      |
| CALCIO            | 180 | 174 | 170 | 192 | 210 | 204 | 214 | 194 | 196 | 182 | 210 | 216 | 190 | 198 | 204 | 210 | 210 | 200 | 200 | 210 | 212 | 188 |            | 198.4    |
| MAGNESIO          | 72  | 74  | 98  | 102 | 100 | 92  | 92  | 102 | 88  | 96  | 70  | 70  | 136 | 126 | 114 | 116 | 120 | 118 | 140 | 130 | 116 | 122 |            | 104.3    |
| SDT               | 465 | 465 | 477 | 495 | 503 | 542 | 534 | 527 | 520 | 517 | 603 | 599 | 596 | 570 | 627 | 612 | 616 | 624 | 616 | 624 | 612 | 640 | 1000 MG/LT | 562.5    |

Realizó

  
 Q.F. MIRIAM CAVAZOS GARCIA  
 JEFE DE LABORATORIO

Vo.Bo

  
 BIOL. JUAN GUILLERMO NAVA LUJANO  
 COORDINADOR DE CALIDAD DEL AGUA

  
 RECIBIDO  
 08/II/2018



RECIBI ING. FRANCISCO DURAZO MENDOZA  
