

PLANTA POTABILIZADORA PASTOR LOZANO

ANÁLISIS FÍSICOQUÍMICOS  
AGUA POTABLE  
FEBRERO 2019

RESULTADOS EN MG/LT


FECHA	1	5	6	7	8	11	12	13	14	15	18	19	20	21	22	25	26	27	28	NON- 127/94	PROMEDIO	
TURBIEDAD N.T.U.	5.0	4.9	4.6	4.9	5.0	4.8	4.9	5.0	5.0	4.8	5.0	5.0	4.9	4.7	5.0	5.0	4.9	5.0	5.0	5.0	5 NTU.	4.9
P.H.	7.4	7.3	7.5	7.2	7.4	7.2	7.3	7.2	7.4	7.2	7.2	7.3	7.4	7.2	7.3	7.2	7.5	7.2	7.3	7.3	6.5-8.5	7.3
ALCALINIDAD TOTAL	114	122	122	118	110	126	130	126	130	128	114	106	130	122	130	102	106	112	120			119.4
DUREZA TOTAL	344	340	356	352	354	350	346	330	340	350	340	340	348	350	352	340	330	336	344	500 MG/LT		344.3
CLORUFOS	216	234	239	239	237	228	219	208	222	217	217	231	222	228	225	233	230	203	230	250 MG/LT		225.2
COLOR RESIDUAL	1.5	1.5	1.5	1.5	1.2	1.3	1.5	1.4	1.0	1.4	1.2	1.1	1.4	1.3	1.3	1.4	1.4	1.4	1.2			1.3
DUREZA DE CALCIO	218	200	222	212	206	230	234	216	226	204	194	208	206	204	218	214	204	202	188			210.8
D. DE MAGNESIO	126	140	134	140	148	120	112	114	114	146	146	132	142	146	134	126	126	134	156			133.5
SDT	847	778	752	750	760	697	683	643	686	662	679	637	637	640	633	625	627	637	630	1000 MG/LT		684.4

AUTORIZO:

QFB MIRIAM CAVAZOS GARCIA  
RESPONSABLE DE LABORATORIO

Vo. B.

BIOLOGO GUILLERMO NAVA LUIANO  
COORDINADOR DE CALIDAD DEL AGUA

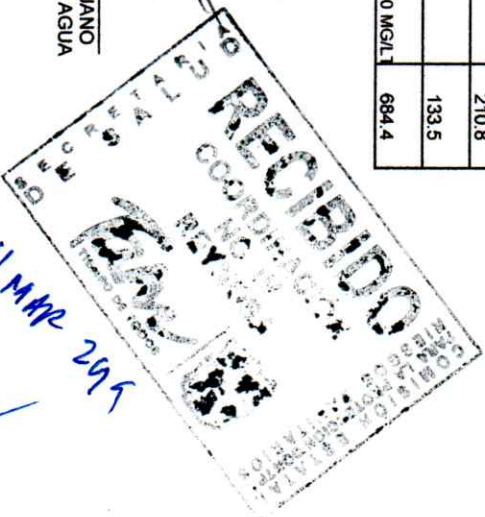

11 MAR 2019

*[Handwritten signature]*