

PLANTA POTABILIZADORA PASTOR LOZANO


ANALISIS FISICOQUIMICOS  
AGUA POTABLE  
MAYO 2019

RESULTADOS EN MG/LT																															
FECHA:	2	3	6	7	8	9	13	14	15	16	17	20	21	22	23	24	27	28	29	30	31	NOM- 127/94	PROMEDIO								
TURBIEDAD N.T.U.	4.8	4.8	4.3	4.5	4.4	4.9	4.9	4.8	4.3	4.4	4.9	4.4	4.9	4.7	4.8	4.3	4.1	4.6	4.8	4.9	4.1	5 NTU.	4.6								
P.H.	7.1	7.2	7.4	7.6	7.2	7.2	7.1	7.3	7.5	7.2	7.2	7.2	7.1	7.2	7.5	7.1	7.0	7.5	7.4	7.2	6.6	6.5-8.5	7.2								
ALCALINIDAD TOTAL	144	136	160	149	136	160	160	146	174	162	162	168	160	154	162	168	148	154	174	158	162		157.0								
DUREZA TOTAL	308	314	298	310	290	296	332	314	388	330	336	352	348	362	350	348	318	340	344	352	346	500 MG/LT	332.2								
CLORUROS	118	97	106	123	140	140	105	140	111	101	215	218	226	223	220	232	218	224	215	251	230	250 MG/LT	174.0								
CLORO RESIDUAL	1.3	1.5	1.0	1.5	1.4	1.1	1.4	1.5	0.9	1.0	0.9	0.7	0.7	0.6	0.8	0.7	0.9	0.1	0.7	0.5	1.5		1.0								
DUREZA DE CALCIO	194	198	210	210	204	204	216	180	234	216	220	238	238	220	224	212	216	250	208	214	210		215.0								
D. DE MAGNESIO	114	116	88	100	86	92	116	134	154	114	116	114	110	142	126	136	102	90	136	138	136		117.1								
SDT	623	646	643	594	593	615	671	766	775	764	765	778	735	730	789	787	88.2	883	880	762	754	1000 MG/LT	697.2								

AUTORIZO:

*P.A.*  
QFB. MIRIAM GAVAZOS GARCIA  
RESPONSABLE DE LABORATORIO

Vo.Bo.  
BIÓLOGO GUILLERMO NAVA LEZANO COORDINADOR DE CALIDAD DEL AGUA

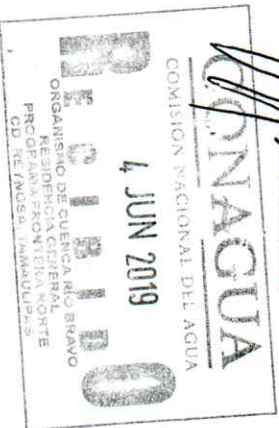

Recibido  
C. S. Sham