

PLANTA POTABILIZADORA PASTOR LOZANO
ANÁLISIS FÍSICOQUÍMICOS
AGUA POTABLE
JULIO 2019


RESULTADOS EN MG/LT

FECHA:	1	2	3	4	5	8	9	10	11	12	15	16	17	18	19	22	23	24	25	26	29	30	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	5.0	5.9	5.5	5.3	6.0	8.6	9.4	8.9	8.8	6.4	5.8	4.7	5.0	5.1	5.7	8.4	7.3	9.3	10.5	9.5	8.2	9.1	8.8	5 NTU.	7.3
P.H.	7.1	6.9	7.5	6.8	6.7	7.1	6.7	6.7	6.7	6.7	6.9	6.7	6.9	6.6	6.6	7.1	7.2	7.3	7.1	7.0	7.1	7.4	7.6	6.5-8.5	7.0
ALCALINIDAD TOTAL	148	172	174	154	166	140	134	154	160	130	172	152	136	180	160	140	175	156	160	152	154	152	169		156.1
DUREZA TOTAL	322	318	324	332	354	354	340	360	350	316	280	270	280	280	280	300	320	298	296	300	310	284	310	500 MG/LT	311.2
CLORUROS	225	230	172	245	253	246	240	250	196	290	180	175	175	190	185	200	195	180	210	186	175	165	176	250 MG/LT	206.0
CLORO RESIDUAL	0.90	1.20	1.40	0.60	1.30	0.80	1.40	1.50	1.40	0.50	1.50	1.50	1.30	1.50	1.50	1.40	1.50	1.30	1.30	1.50	1.20	1.10	1.50		1.27
DUREZA DE CALCIO	192	210	196	206	228	196	214	102	196	200	170	180	198	172	180	176	198	182	190	186	192	194	190		189.0
D. DE MAGNESIO	130	108	128	126	126	158	126	156	154	116	110	100	82	108	80	124	122	116	106	114	118	90	120		118.2
SDT	579	685	721	727	1050	664	1036	908	875	794	739	719	719	743	730	767	995	737	700	646	653	634	662	1000 MG/LT	759.9

AUTORIZÓ:

Miriam Cava
DRA. MIRIAM CAVAZOS GARGA
RESPONSABLE DE LABORATORIO

Yo. Bo.
Guillermo Nava
BIÓLOGO GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA

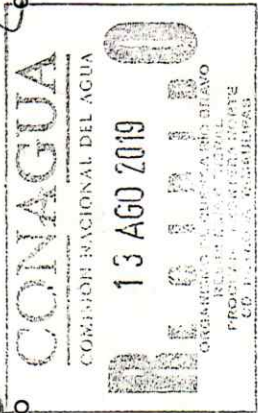

Dona e Diana

13/08/2019

