


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA POTABLE
 mar-17

RESULTADOS EN MG/LT


FECHA:	1	2	3	6	7	8	9	10	13	14	15	16	17	21	22	23	24	27	28	29	30	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	2.3	4.2	3.4	2.8	2.6	3.6	3.0	3.3	3.0	2.8	3.4	2.6	3.7	3.9	3.2	4.1	4.0	4.9	4.2	4.7	5.8	6.1	5 NTU.	3.4
P.H.	7.9	7.7	7.9	7.6	7.6	7.3	7.7	7.6	7.3	7.6	7.4	7.5	7.6	7.3	7.5	7.4	7.7	7.5	7.4	7.5	7.5	7.5	6.5-8.5	7.6
ALCALINIDAD TOTAL	118	106	116	112	126	126	138	130	126	102	100	106	108	108	110	108	102	102	96	92	90	76		112.5
DUREZA TOTAL	270	318	288	270	310	240	246	240	214	264	304	300	290	260	330	320	336	270	264	300	308	184	500 MG/LT	280.7
CLORUROS	175	182	203	108	180	172	146	182	172	179	183	176	170	184	216	215	197	250	175	184	165	180	250 MG/LT	182.4
CLORO RESIDUAL	1.42	1.5	1.52	1.28	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.2	1.5	1.5	1.5	1.5	1.5	1.5		1.5
CALCIO	210	216	190	180	216	520	168	190	156	180	194	170	180	196	180	220	182	200	198	170	188	148		202.4
MAGNESIO	60	102	98	90	94	78	78	50	58	54	110	130	110	64	150	100	154	70	66	130	120	36		90.3
SDT	511	518	608	509	508	520	519	524	523	593	532	518	544	550	585	625	615	526	535	543	548	547	1000 MG/LT	545.3

Realizó

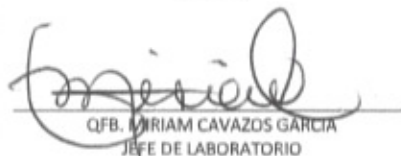

QFB. MIRIAM CAVAZOS GARCIA
 JEFE DE LABORATORIO

Vo. Bo

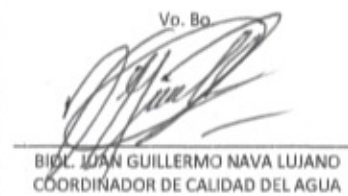

BIDL. JOAN GUILLERMO NAVA LUJANO
 COORDINADOR DE CALIDAD DEL AGUA