

PLANTA POTABILIZADORA PASTOR LOZANO

ANÁLISIS FÍSICOQUÍMICOS
AGUA POTABLE
SEPTIEMBRE 2020

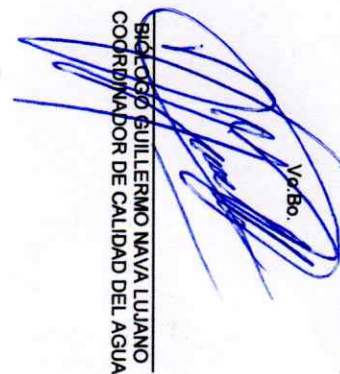
RESULTADOS EN MG/LT

FECHA:	1	2	3	4	7	8	9	10	11	14	15	17	18	21	22	23	24	25	28	29	30	NOM- 127/94	PROMEDIO
TURBIEDAD N.T.U.	5.0	4.8	4.9	4.9	5.0	4.7	4.7	4.8	5.0	5.0	4.6	5.0	4.9	4.8	4.8	5.0	5.0	5.0	4.9	5.0	5.0	5 NTU	4.9
P.H.	7.6	7.5	7.6	6.9	7.5	7.3	7.5	7.3	7.4	7.5	7.5	7.3	7.3	7.2	7.4	7.4	7.5	7.6	7.5	7.5	7.5	6.5-8.5	7.4
ALCALINIDAD TOTAL	106	108	110	108	108	110	112	104	114	114	110	114	112	126	124	110	118	120	124	116	108		113.1
DUREZA TOTAL	372	372	344	330	320	330	322	320	330	340	344	326	308	384	380	372	372	384	368	404	376	500 MG/LT	352.3
DUREZA DE CALCIO	234	242	180	184	166	200	168	186	178	204	184	178	214	226	246	190	224	234	222	230	238		206.1
D. DE MAGNESIO	138	130	164	146	154	130	154	134	152	136	160	148	94	158	134	182	148	150	146	174	138		146.2
CLORUROS	260	233	222	216	185	197	195	194	192	221	218	207	210	283	298	283	287	280	300	300	300	250 MG/LT	242.0
COLORO DE RESIDUAL	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
SDT	836	771	652	670	627	573	567	634	646	682	644	807	527	869	934	888	851	817	1000	909	945	1000 MG/LT	754.6
TEMPERATURA °C	30	29	30	29	29	29	28	27	26	28	28	28	26	26	26	27	27	26	28	26	26		27.5

AUTORIZO:


QFB MIRIAM CAVAZOS GARCIA
RESPONSABLE DE LABORATORIO

VerBo.


BICOGG GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA