

PLANTA POTABILIZADORA PASTOR LOZANO

ANÁLISIS FÍSICOQUÍMICOS
AGUA POTABLE
NOVIEMBRE 2020

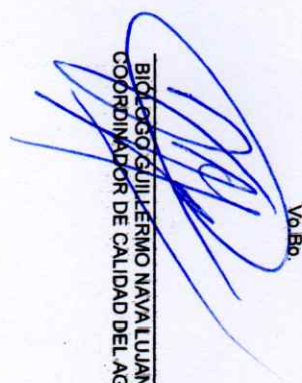
RESULTADOS EN MG/LT

FECHA:	2	3	4	5	6	9	10	11	12	13	17	18	19	20	23	24	25	26	27	30	NOM- 127/94	PROMEDIO
TURBIDEZ N.T.U.	5.0	5.0	4.0	5.0	3.7	5.0	4.7	4.9	4.8	5.0	5.0	4.8	4.2	4.5	4.9	5.0	4.8	4.7	4.3	5.0	5 NTU.	4.7
P.H.	7.7	7.5	7.5	7.7	7.9	7.5	7.5	7.7	7.7	7.7	7.8	7.9	7.6	7.6	7.6	7.6	7.7	7.5	7.3	7.6	6.5-8.5	7.6
ALCALINIDAD TOTAL	130	133	132	134	130	134	134	137	136	134	134	128	130	132	126	132	128	134	134	144		132.8
DUREZA TOTAL	340	342	339	344	346	348	337	322	336	338	350	344	344	328	328	304	350	360	368	362	500 MG/LT	341.5
DUREZA DE CALCIO	218	222	218	217	222	221	217	205	220	226	218	196	186	208	168	183	188	220	225	226		210.2
D. DE MAGNESIO	122	120	121	127	124	127	120	117	116	112	132	148	158	120	160	121	162	140	143	136		131.3
CLORUROS	173	182	173	185	180	167	172	188	194	204	186	199	186	193	187	193	208	207	234	250 MG/LT		190.2
CLORO DE RESIDUAL	1.4	1.5	1.2	1.3	1.5	1.5	1.5	1.4	1.5	1.5	1.5	1.4	1.4	1.5	1.4	1.5	1.4	1.3	1.5	0.2-1.5 MG/LT		1.4
SDT	689	690	650	696	640	600	605	598	628	616	600	654	687	581	550	605	665	641	713	750 MG/LT		642.9
TEMPERATURA °C	22	22	22	23	23	24	25	24	25	24	24	23	23	23	24	24	23	24	24	21		23.3

AUTORIZO:


QFB MIRIAM CAMACHO GARCÍA
RESPONSABLE DE LABORATORIO

Yo Bo.


BIÓLOGO GUILLERMO NAVALLUANO
COORDINADOR DE CALIDAD DEL AGUA