


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUÍMICOS
AGUA CRUDA
mar-17

RESULTADOS EN MG/LT


FECHA:	1	2	3	6	7	8	9	10	13	14	15	16	17	21	22	23	24	27	28	29	30	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	13.9	13.2	8.7	14.4	10.5	9.6	9.5	7.8	5.7	12.9	11.1	10.9	8.1	9.0	6.2	8.3	9.1	8.4	8.3	11.2	12.7	10.3	5 NTU.	10.0
P.H.	8.1	8	7.7	7.8	8.05	8.1	8.08	8.1	7.9	7.8	8.1	7.91	8.01	8.2	8.5	8.4	8.2	8.5	8.19	7.6	8.4	8.2	6.5-8.5	8.1
ALCALINIDAD TOTAL	122	114	122	118	132	118	126	142	114	110	106	110	114	98	118	116	100	108	106	100	96	84		112.5
DUREZA TOTAL	310	322	302	260	260	269	230	230	206	224	300	290	320	270	320	312	320	266	256	290	284	172	500 MG/LT	273.3
CLORUROS	172	179	189	165	170	160	174	175	164	167	156	173	163	173	200	216	187	240	165	150	158	166	250 MG/LT	175.5
CALCIO	214	212	202	170	200	156	186	190	128	190	182	186	190	190	200	180	180	196	194	170	188	156		184.5
MAGNESIO	96	110	100	90	60	113	44	40	78	34	118	104	130	80	120	150	140	70	62	120	96	16		89.6
SDT	513	521	601	499	498	498	532	533	509	533	503	508.5	508	520	585	585	605	492	492	492.5	493	489	1000 MG/LT	523.0

Realizó



DRS. MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

Vo. Bo.

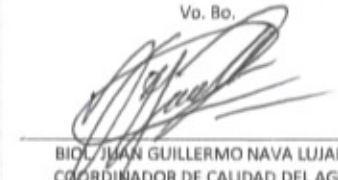

BIOLOGO JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA