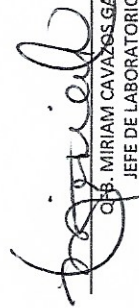


PLANTA POTABILIZADORA PASTOR LOZANO
ANÁLISIS FÍSICOQUÍMICOS
AGUA POTABLE
may-18

RESULTADOS EN MG/LT

FECHA:	2	3	4	7	8	9	10	11	14	15	16	17	18	21	22	23	24	25	28	29	30	31	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	4.9	5.0	4.8	5.1	4.9	5.0	4.9	5.0	5.0	5.0	5.0	5.0	4.8	5.0	5.0	5.0	4.5	4.9	5.0	5.0	4.8	5	5 NTU.	4.9
P.H.	7.6	7.6	7.6	7.4	7.3	7.6	7.5	7.6	7.6	7.4	7.2	7.3	7.6	7.4	7.2	7.4	7.4	7.6	7.7	7.4	7.4	7.3	6.5-8.5	7.4
ALCALINIDAD TOTAL	86	76	78	74	62	76	78	76	76	74	84	88	80	78	96	90	80	94	86	9	84	96	78.2	78.2
DUREZA TOTAL	340	320	330	316	310	330	322	312	284	300	328	320	310	330	300	356	316	386	240	316	322	308	500 MG/LT	317.1
CLORUROS	160	140	185	130	170	167	163	160	162	190	160	158	183	172	180	185	189	230	172	185	205	211	250 MG/LT	175.3
CLORO RESIDUAL	1.5	1.4	1.3	1.5	1.2	1.0	1.5	1.5	1.4	1.5	1.5	1.5	1.5	1.5	1.4	1.1	1.1	1.5	1.0	1.5	1.5	1.5	1.4	1.4
CALCIO	208	200	200	184	176	198	208	210	160	186	174	200	100	174	120	186	140	212	124	112	120	186	171.7	171.7
MAGNESIO	132	120	130	132	134	132	114	102	104	114	154	120	210	156	180	170	176	174	116	204	202	122	145.4	145.4
SDT	654	656	547	538	530	535	519	526	512	509	506	508	511	512	527	510	508	643	696	709	688	672	1000 MG/LT	568.9

Realizó


C.B. MIRIAM CAVAZOS GARGÁ
JEFE DE LABORATORIO




Vo. 657

BIG. JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA



COMISION NACIONAL DEL AGUA
ORGANISMO

12/06/18