


PLANTA POTABILIZADORA PASTOR LOZANO  
ANALISIS FISICOQUÍMICOS  
AGUA POTABLE  
abr-17

RESULTADOS EN MG/LT


FECHA:	3	4	5	6	7	10	11	12	17	18	19	20	21	24	25	26	27	28	NOM-127/94	PROMEDIO
TURBIEDAD N.T.U.	5.0	5.0	4.8	4.9	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	4	5 NTU.	4.9
P.H.	7.6	7.5	7.6	7.4	7.1	7.3	7.3	7.5	7.3	7.6	7.5	7.5	7.5	7.7	7.4	7.6	7.1	7.4	6.5-8.5	7.4
ALCALINIDAD TOTAL	72	84	82	86	80	90	90	90	88	90	110	112	132	88	96	76	98	92		92.0
DUREZA TOTAL	288	290	304	310	318	326	300	308	264	314	296	264	280	292	280	320	312	330	500 MG/LT	299.8
CLORUROS	174	179	173	165	170	165	184	185	178	176	172	182	183	170	189	190	190	200	250 MG/LT	179.2
CLORO RESIDUAL	1.4	1.5	1.3	1.4	1	1	1.5	1.5	1.1	1	1	1.1	1	1	1.5	1.5	1.3	1.4		1.3
CALCIO	170	189	196	186	180	158	160	184	140	176	140	126	132	170	180	220	190	190		171.5
MAGNESIO	118	101	108	124	138	168	140	124	124	138	156	138	148	122	100	100	122	140		128.3
SDT	551.5	541	541	535	565	544	470	532	537	550	537	537	544	530	542	528	542.5	549	1000 MG/LT	537.6

Realizó

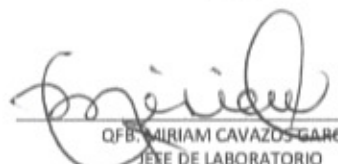

QFB. MIRIAM CAVAZOS GARCIA  
JEFE DE LABORATORIO

Vo.Bo



BIV. JUAN GUILLERMO NAVA LUJANO  
COORDINADOR DE CALIDAD DEL AGUA