


PLANTA POTABILIZADORA PASTOR LOZANO
ANALISIS FISICOQUIMICOS
AGUA CRUDA
jul-18

RESULTADOS EN MG/LT


FECHA:	2	3	4	5	6	9	10	11	12	13	16	17	18	19	20	23	24	25	26	27	30	31	NOM- 127/94	PROMEDIO
TURBIEDAD N.T.U.	15.8	19.6	19.2	20.2	21.2	17.9	20.0	18.2	16.0	18.3	19.8	19.2	19.2	19.1	20.8	20.0	22.5	24.6	21.8	24.0	20.9	19.5	5 NTU	19.9
P.H.	7.1	7.1	7.3	7.5	7.4	7.4	7.1	7.0	7.5	7.5	7.4	3.0	7.5	7.5	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.3	6.5-8.5	7.4
ALCALINIDAD TOTAL	100	120	106	124	120	120	124	110	96	100	80	94	104	106	85	90	96	84	98	98	92	108		102.5
DUREZA TOTAL	250	240	250	240	250	240	250	250	240	248	250	240	250	250	240	250	250	250	250	248	248	250	500 MG/LT	247.0
CLORUROS	276	318	312	312	355	366	340	283	250	213	196	224	210	201	195	170	184	159	159	163	173	172	250 MG/LT	237.8
CLORO RESIDUAL																								
CALCIO	150	144	172	168	232	180	186	150	150	170	130	160	123	126	124	164	122	144	140	160	90	150		151.8
MAGNESIO	160	174	156	152	118	180	84	178	170	138	148	144	172	144	155	168	148	106	126	106	152	114		145.2
SDT	746	761	711	922	685	740	600	472	431	403	395	328	322	334	271	623	625	533	509	506	545	483	1000 MG/LT	540.2

Realizó

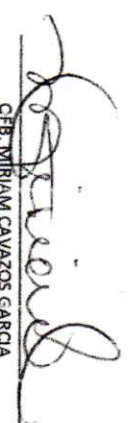

C.F.B. MIRIAM CAVAZOS GARCIA
JEFE DE LABORATORIO

No. Boq.

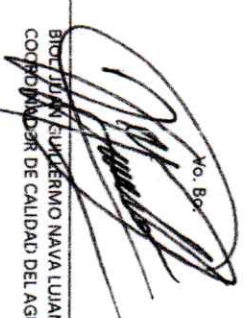

BIOE JUAN GUILLERMO NAVA LUJANO
COORDINADOR DE CALIDAD DEL AGUA

Recibido
08 de Agosto
2018



RECIBI EL 08 AGO - 2018